


COOLING

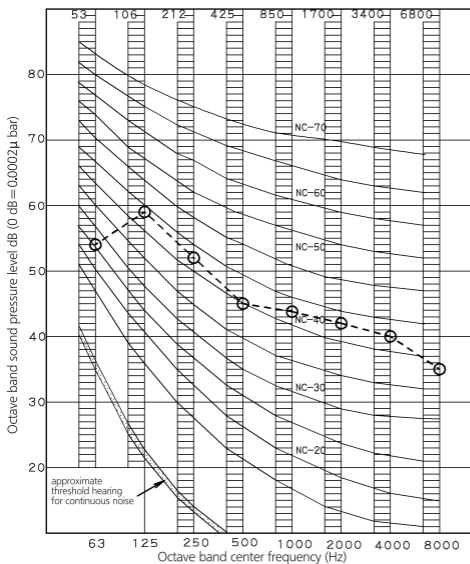

NOTES

- 1 Overall (dB)

Scale	50Hz 220V-240V 60Hz 220V-230V
A	48


(B,G,N is already rectified)

- 2 Measuring place: Measure in anechoic room
- 3 Operation noise differs with operation and ambient conditions.
- 4 Operating conditions: Power source 220-240V/220-230V 50/60Hz
 ○—○ 50/60Hz 220-240V/220-230V
 Cooling
- 5 Location of microphone

JISC9612

The operation noise measuring method is in accordance with JISC9612

HEATING

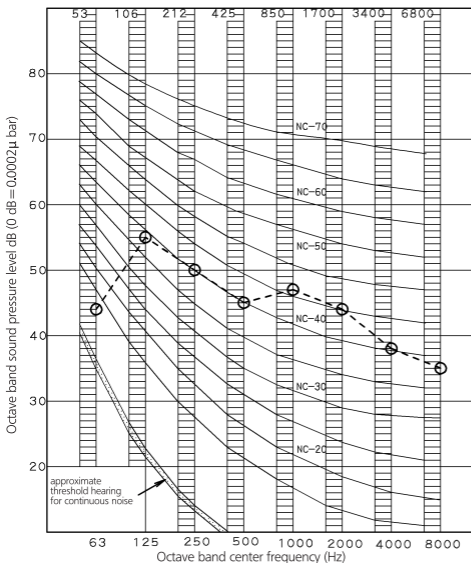

NOTES

- 1 Overall (dB)

Scale	50Hz 220V-240V 60Hz 220V-230V
A	49

(B,G,N is already rectified)

- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 220-240V/220-230V 50/60Hz
○—○ 50/60Hz 220-240V/220-230V
Heating
- Location of microphone
JIS9612
The operation noise measuring method is in accordance with JIS9612