

Aer condiționat
pentru un
C°nfort Perfect!

The logo for DAIKIN, featuring a blue and black stylized 'D' symbol followed by the word 'DAIKIN' in bold blue capital letters.




Te așteptăm în showroom-ul nostru!

The logo for BUENO TECH, featuring a green leaf icon to the left of the text 'BUENO TECH' in blue and red, with the tagline 'Profesionalism, Experiență, Calitate.' below it.

Mobil: 0755 054 411
Fix: 0318 109 504
Fax: 0318 149 790

E-mail: office@buenotech.ro
Site: www.buenotech-shop.ro
Adresa: Str. Melade Între Vi, nr. 8,
Sec. 2, București

COOLING

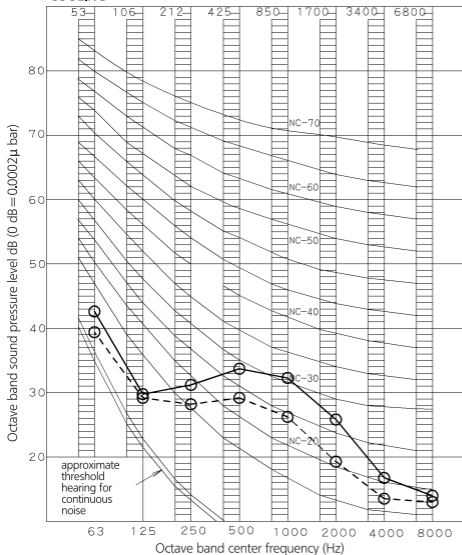


NOTES

1 Overall (dB)

Scale	50Hz 230V (H) (H)	50Hz 230V (L) (L)
A	38	32


(B,G,N is already rectified)

- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 230V 50Hz
JIS Standard
- Standard external static pressure
 ○—○ 50 Hz 230V (H)
 ○---○ 50 Hz 230V (L)
 Cooling
- Location of microphone
JISC9612



The operation noise measuring method is in accordance with JISC9612

HEATING

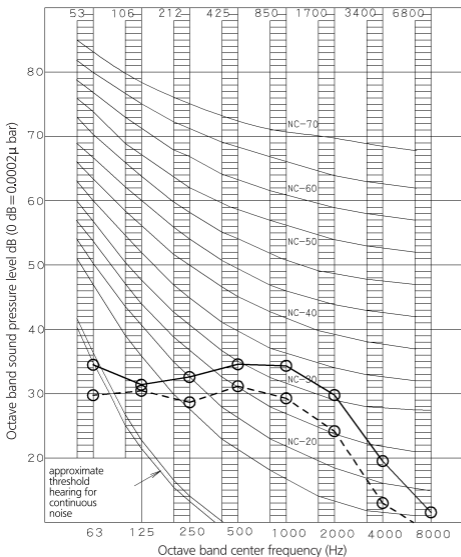


NOTES

1 Overall (dB)

Scale	50Hz 230V (H) (H)	50Hz 230V (L) (L)
A	39	33


(B,G,N is already rectified)

- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 230V 50Hz
JIS Standard
- Standard external static pressure
 ○—○ 50 Hz 230V (H)
 ○---○ 50 Hz 230V (L)
 Heating
- Location of microphone
JIS9612



The operation noise measuring method is in accordance with JISC9612

COOLING

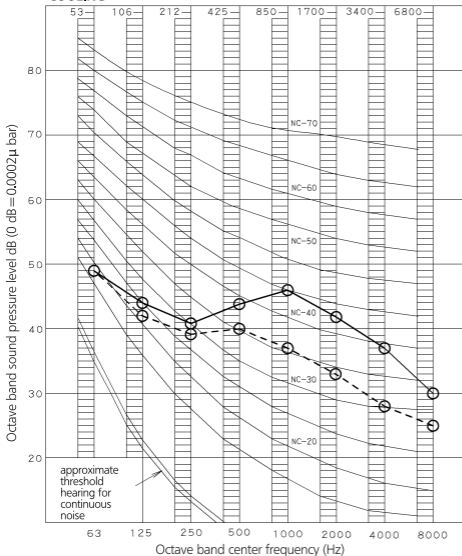


NOTES

- Overall (dB)

Scale	50Hz 230V (H) (H)	50Hz 230V (L) (L)
A	47	39


(B,G,N is already rectified)

- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 230V 50Hz
JIS Standard
- Standard external static pressure
 ○—○ 50 Hz 230V (H)
 ○---○ 50 Hz 230V (L)
 Cooling
- Location of microphone
JISC9612



The operation noise measuring method is in accordance with JISC9612

HEATING

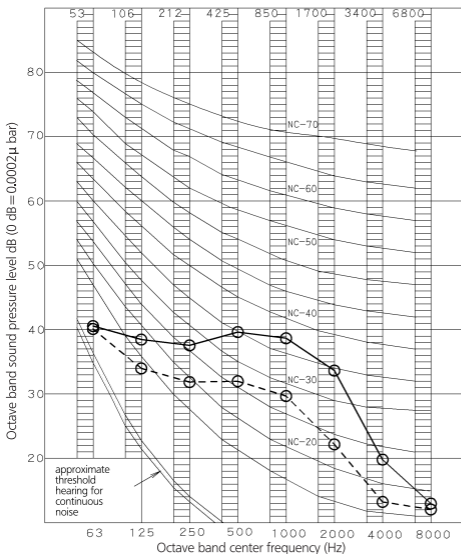

NOTES

1 Overall (dB)


Scale	50Hz 230V (H) (H)	50Hz 230V (L) (L)
A	46	35

(B,G,N is already rectified)


- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 230V 50Hz
JIS Standard
- Standard external static pressure
 ○—○ 50 Hz 230V (H)
 ○---○ 50 Hz 230V (L)
 Heating

- Location of microphone
JISC9612

The operation noise measuring method is in accordance with JISC9612



COOLING

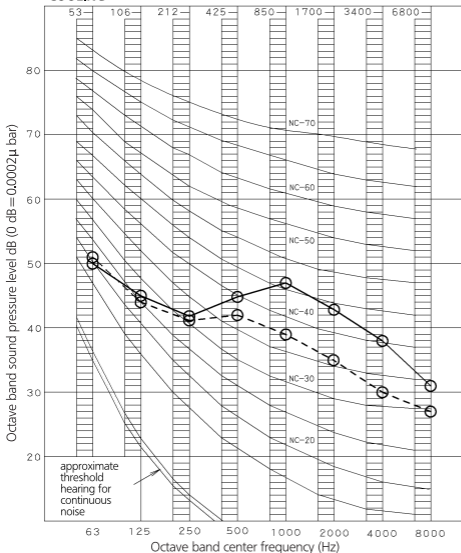


NOTES

1 Overall (dB)

Scale	50Hz 230V (H) (H)	50Hz 230V (L) (L)
A	48	41


(B,G,N is already rectified)

- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 230V 50Hz
JIS Standard
- Standard external static pressure
 ○—○ 50 Hz 230V (H)
 ○---○ 50 Hz 230V (L)
 Cooling
- Location of microphone
JISC9612



The operation noise measuring method is in accordance with JISC9612

HEATING

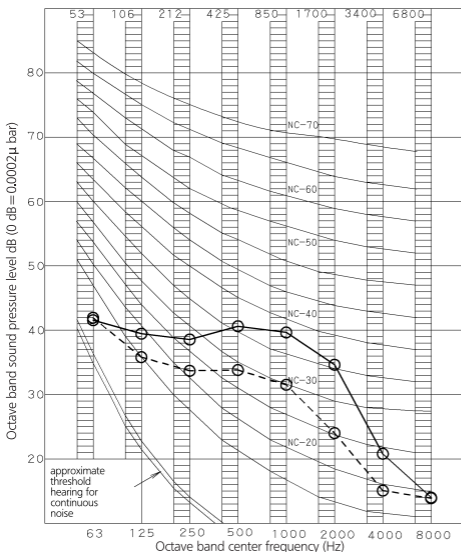


NOTES

1 Overall (dB)

Scale	50Hz 230V (H) (H)	50Hz 230V (L) (L)
A	47	37

(B,G,N is already rectified)

- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 230V 50Hz
JIS Standard
- Standard external static pressure
 ○—○ 50 Hz 230V (H)
 ○---○ 50 Hz 230V (L)
 Heating
- Location of microphone
JISC9612



The operation noise measuring method is in accordance with JISC9612