
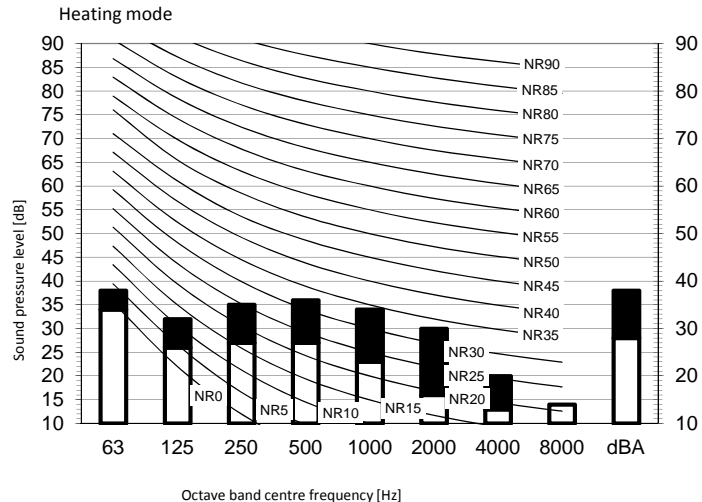


CTXS15K

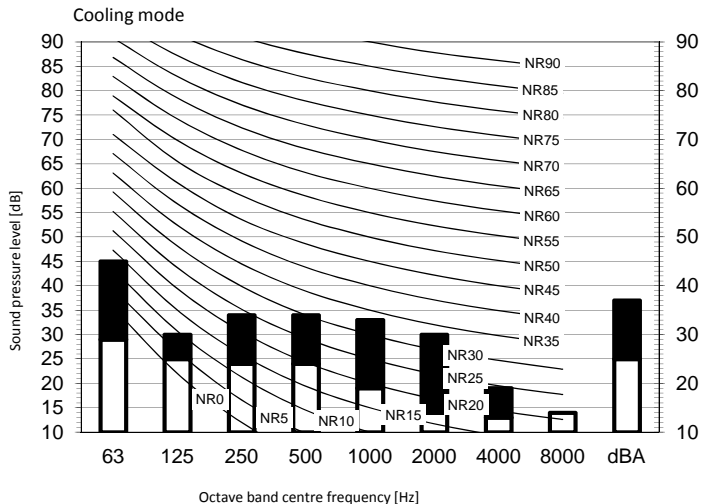

Legend


dBA = A-weighted sound pressure level (A scale according to IEC).

A Scale

B High-tap

C Low-tap

Location of microphone




Cooling	Total dB	
A	B	C
dBA	37	25

Heating	Total dB	
A	B	C
dBA	38	28


Notes

1. Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
2. Background noise already taken into account.
3. Operating noise varies depending on operation and ambient conditions.
4. The operation noise measuring method is in accordance with JISC9612.
5. Measuring location: anechoic chamber

Cooling

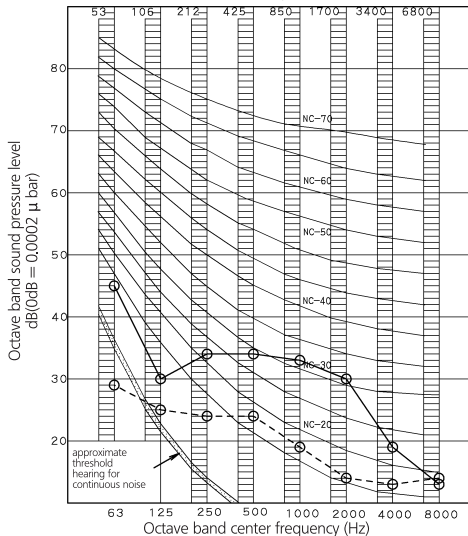


Heating

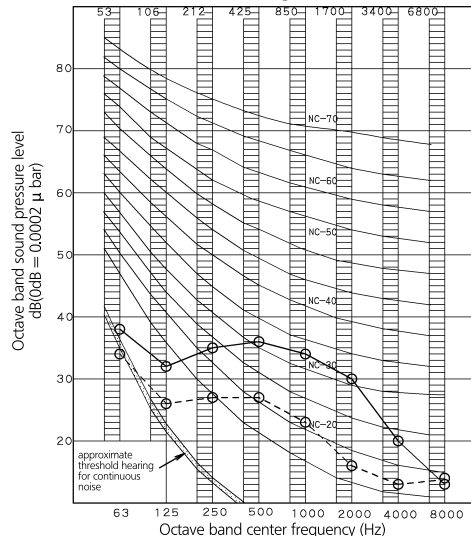

NOTES

- Overall (dB)
(B,G,N is already rectified)
- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 230V 50Hz
- Location of microphone
JISC9612
The operation noise measuring method is in accordance with JISC9612
- Standard external static pressure
○—○ 50 Hz 230V (H)
○—○ 50 Hz 230V (L)


Scale	50Hz 230V (H)	50Hz 230V (L)
A	37	25





NOTES

- Overall (dB)
(B,G,N is already rectified)
- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 230V 50Hz
- Location of microphone
JISC9612
The operation noise measuring method is in accordance with JISC9612
- Standard external static pressure
○—○ 50 Hz 230V (H)
○—○ 50 Hz 230V (L)

Scale	50Hz 230V (H)	50Hz 230V (L)
A	38	28



CTXS35K

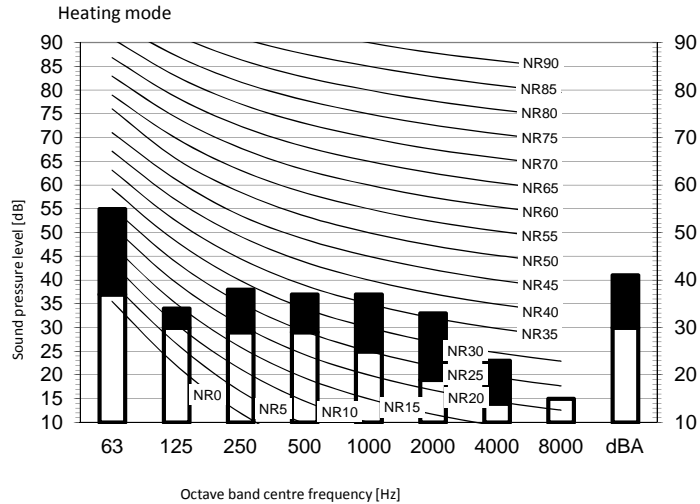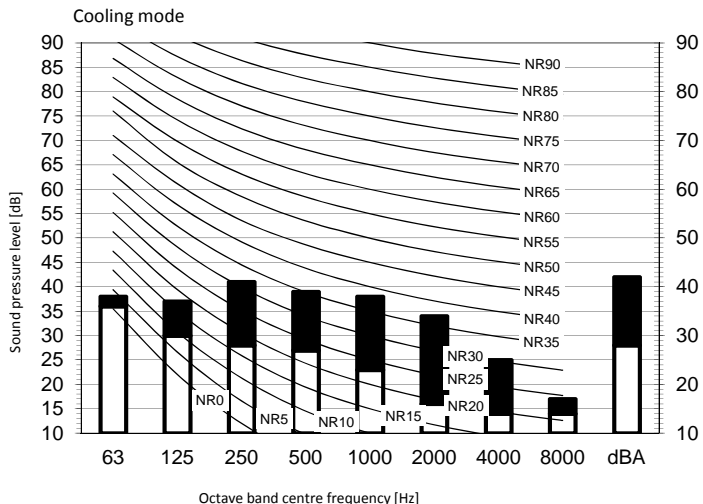

Legend


dBA = A-weighted sound pressure level (A scale according to IEC).

A Scale

B  High-tap

C  Low-tap

Location of microphone




Cooling	Total dB	
A	B	C
dBA	42	28

Heating	Total dB	
A	B	C
dBA	41	30


Notes

1. Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
2. Background noise already taken into account.
3. Operating noise varies depending on operation and ambient conditions.
4. The operation noise measuring method is in accordance with JISC9612.
5. Measuring location: anechoic chamber

Cooling

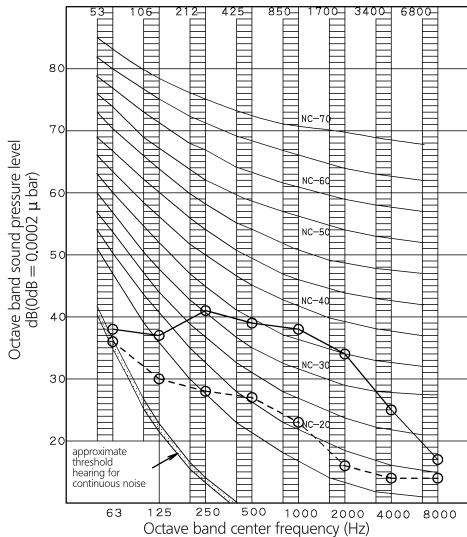


Heating

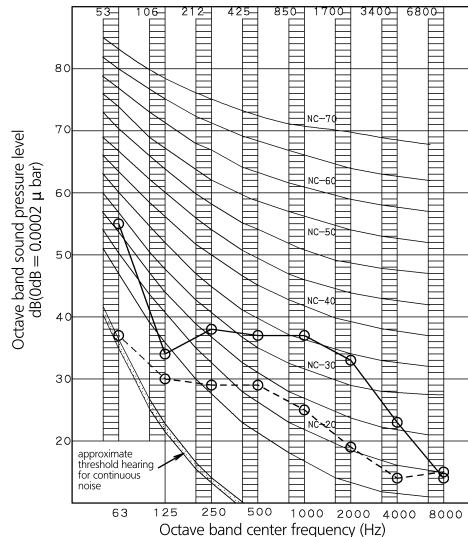

NOTES

- Overall (dB)
(B,G,N is already rectified)
- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 230V 50Hz
- Location of microphone
JISC9612
The operation noise measuring method is in accordance with JISC9612
- Standard external static pressure
○—○ 50 Hz 230V (H)
○—○ 50 Hz 230V (L)

Scale	50Hz 230V (H)	50Hz 230V (L)
A	42	28



NOTES

- Overall (dB)
(B,G,N is already rectified)
- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 230V 50Hz
- Location of microphone
JISC9612
The operation noise measuring method is in accordance with JISC9612
- Standard external static pressure
○—○ 50 Hz 230V (H)
○—○ 50 Hz 230V (L)

Scale	50Hz 230V (H)	50Hz 230V (L)
A	41	30

