

Aer condiționat
pentru un
C°nfort Perfect!

The logo for DAIKIN, featuring a blue and black stylized 'D' symbol followed by the word 'DAIKIN' in bold blue capital letters.




Te așteptăm în showroom-ul nostru!

The logo for BUENO TECH, featuring a green leaf icon to the left of the text 'BUENO TECH' in blue and red, with a registered trademark symbol. Below it, the tagline 'Profesionalism, Experiență, Calitate.' is written in a smaller font.

Mobil: 0755 054 411
Fix: 0318 109 504
Fax: 0318 149 790

E-mail: office@buenotech.ro
Site: www.buenotech-shop.ro
Adresa: Str. Melade Între Vi, nr. 8,
Sec. 2, București

COOLING

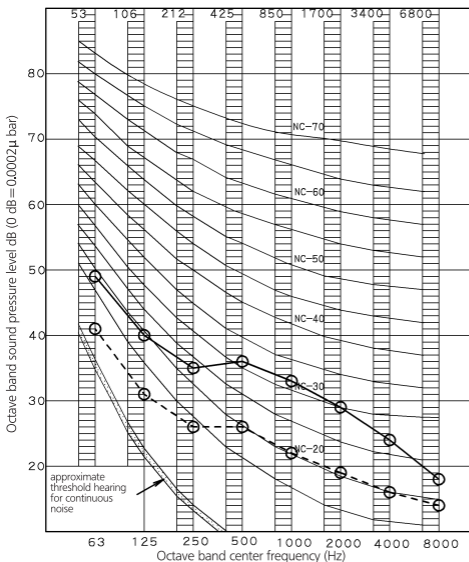

NOTES

- 1 Overall (dB)


Scale	50Hz 220-240V (H)	50Hz 220-240V (L)
A	38	26

(B,G,N is already rectified)

- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 220-240V 50Hz; JIS standard
- Standard external static pressure
- 50 Hz 220-240V (H)
 ○---○ 50 Hz 220-240V (L)
 Cooling
- Location of microphone
The operation noise measuring method is in accordance with JISC9612



HEATING

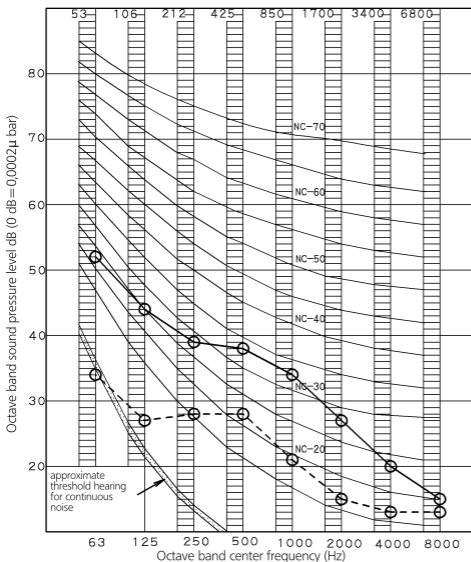

NOTES

- 1 Overall (dB)


Scale	50Hz 220-240V (H)	50Hz 220-240V (L)
A	39	28

(B,G,N is already rectified)

- 2 Measuring place: Measure in anechoic room
- 3 Operation noise differs with operation and ambient conditions.
- 4 Operating conditions: Power source 220-240V 50Hz; JIS standard
- 5 Standard external static pressure
- 50 Hz 220-240V (H)
○---○ 50 Hz 220-240V (L)
- Heating
- 6 Location of microphone
The operation noise measuring method is in accordance with JISC9612



COOLING

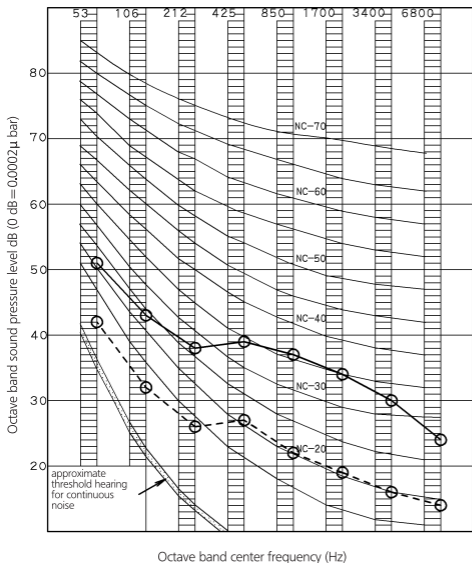

NOTES

1 Overall (dB)

Scale	50Hz 220-240V (H)	50Hz 220-240V (L)
A	42	27

(B,G,N is already rectified)


- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 220-240V 50Hz; JIS standard
- Standard external static pressure
- 50 Hz 220-240V (H)
 ○---○ 50 Hz 220-240V (L)
 Cooling

6 Location of microphone

The operation noise measuring method is in accordance with JISC9612



HEATING

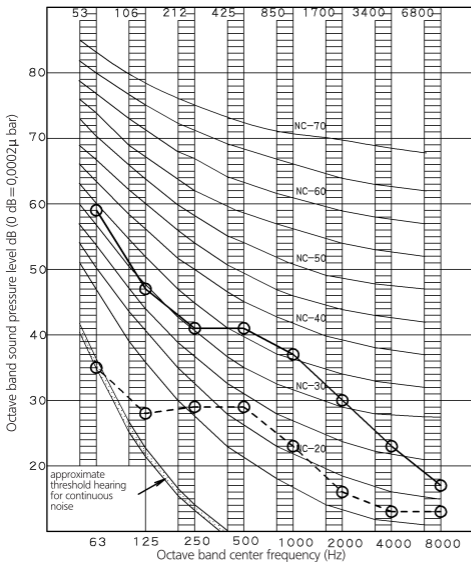

NOTES

- 1 Overall (dB)


Scale	50Hz 220-240V (H)	50Hz 220-240V (L)
A	42	29

(B,G,N is already rectified)

- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 220-240V 50Hz; JIS standard
- Standard external static pressure
- 50 Hz 220-240V (H)
 ○---○ 50 Hz 220-240V (L)
 Heating
- Location of microphone
The operation noise measuring method is in accordance with JISC9612



COOLING

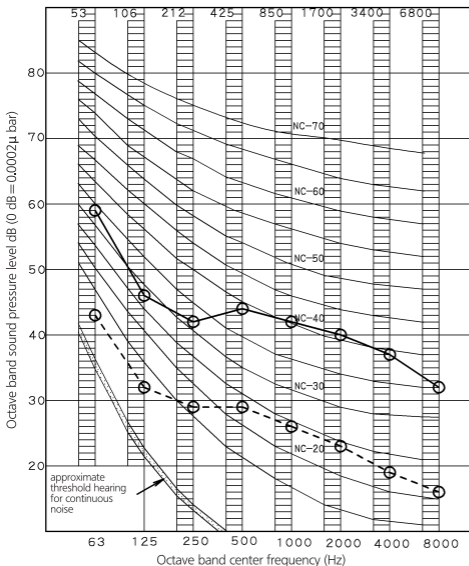

NOTES

- 1 Overall (dB)


Scale	50Hz 220-240V (H)	50Hz 220-240V (L)
A	47	30

(B,G,N is already rectified)

- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 220-240V 50Hz; JIS standard
- Standard external static pressure
- Standard external static pressure
 - 50 Hz 220-240V (H)
 - 50 Hz 220-240V (L)
 Cooling
- Location of microphone
The operation noise measuring method is in accordance with JISC9612



HEATING

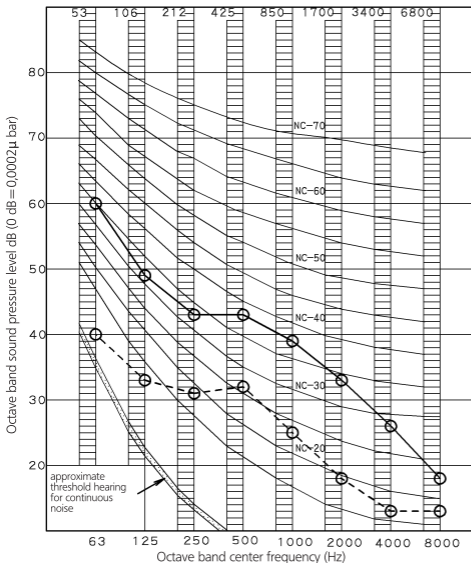

NOTES

- 1 Overall (dB)

Scale	50Hz 220-240V (H)	50Hz 220-240V (L)
A	44	31

(B,G,N is already rectified)

- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 220-240V 50Hz; JIS standard
- Standard external static pressure
- 50 Hz 220-240V (H)
 - 50 Hz 220-240V (L)
 Heating
- Location of microphone
The operation noise measuring method is in accordance with JISC9612

