
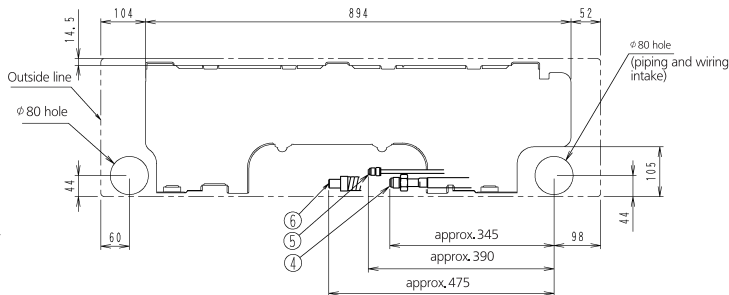
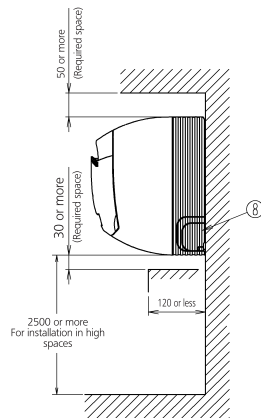
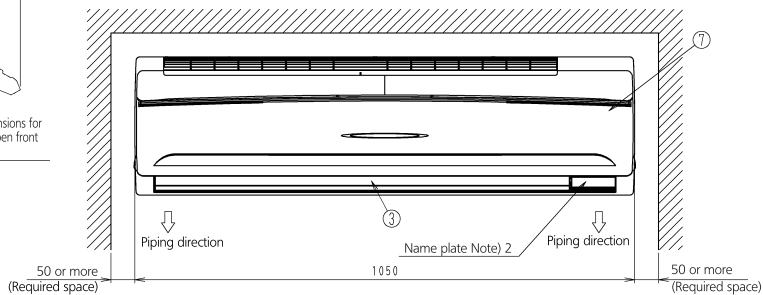


FAQ71C9

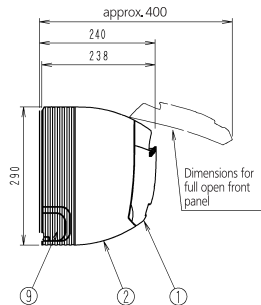


- 1 Front panel
- 2 Front grill
- 3 Air outlet
- 4 Gas pipe ($\phi 15.9$ Flare connection)
- 5 Liquid pipe ($\phi 9.5$ Flare connection)
- 6 Drain hose VP13 (External dia. $\phi 18$)
- 7 Grounding terminal (M4)
- 8 Right side pipe connection hole
- 9 Left side pipe connection hole

Mounting location

Notes:

- 1 Location of unit's name plate: Right side surface of casing.
- 2 In case of using infrared remote controller, this position will be a signal receiver. Refer to the drawing of infrared remote controller in detail.
- 3 Please do not place the thing been damp and troubled under an indoor unit. When the case where humidity is 80% or more, and the drain outlet are choked up and the air filter are dirty, dew may fall.

FAQ100C9

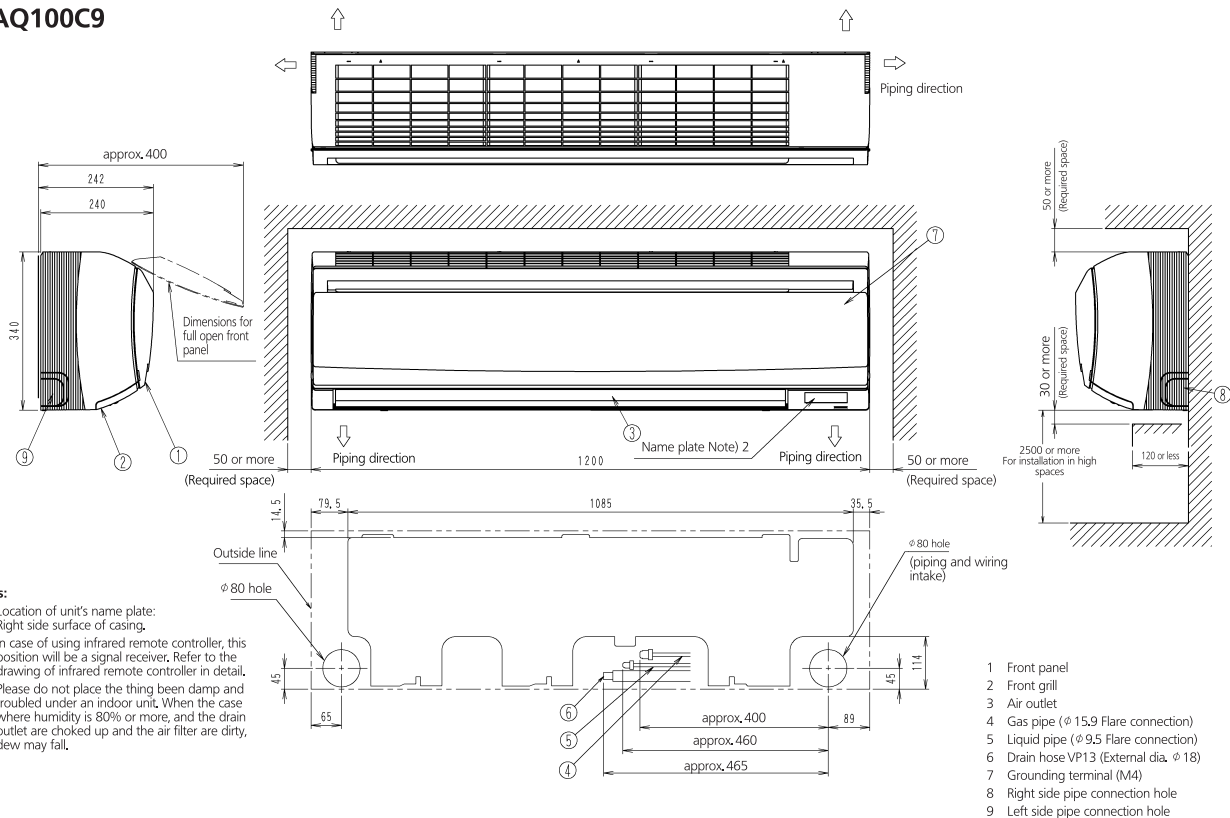

- Notes:**
- 1 Location of unit's name plate: Right side surface of casing.
 - 2 In case of using infrared remote controller, this position will be a signal receiver. Refer to the drawing of infrared remote controller in detail.
 - 3 Please do not place the thing been damp and troubled under an indoor unit. When the case where humidity is 80% or more, and the drain outlet are choked up and the air filter are dirty, dew may fall.

- 1 Front panel
- 2 Front grill
- 3 Air outlet
- 4 Gas pipe ($\phi 15.9$ Flare connection)
- 5 Liquid pipe ($\phi 9.5$ Flare connection)
- 6 Drain hose VP13 (External dia. $\phi 18$)
- 7 Grounding terminal (M4)
- 8 Right side pipe connection hole
- 9 Left side pipe connection hole

Mounting location