



AZQS71BV1

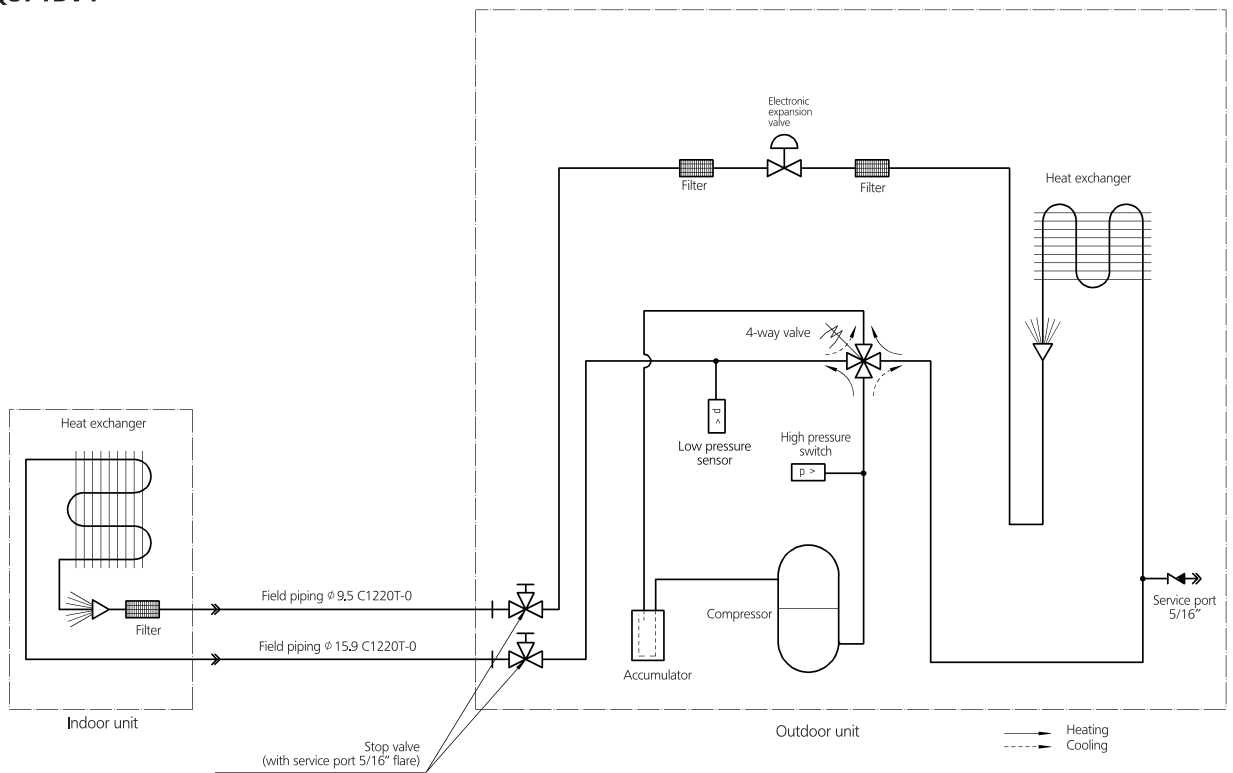


AZQS100-140BV1

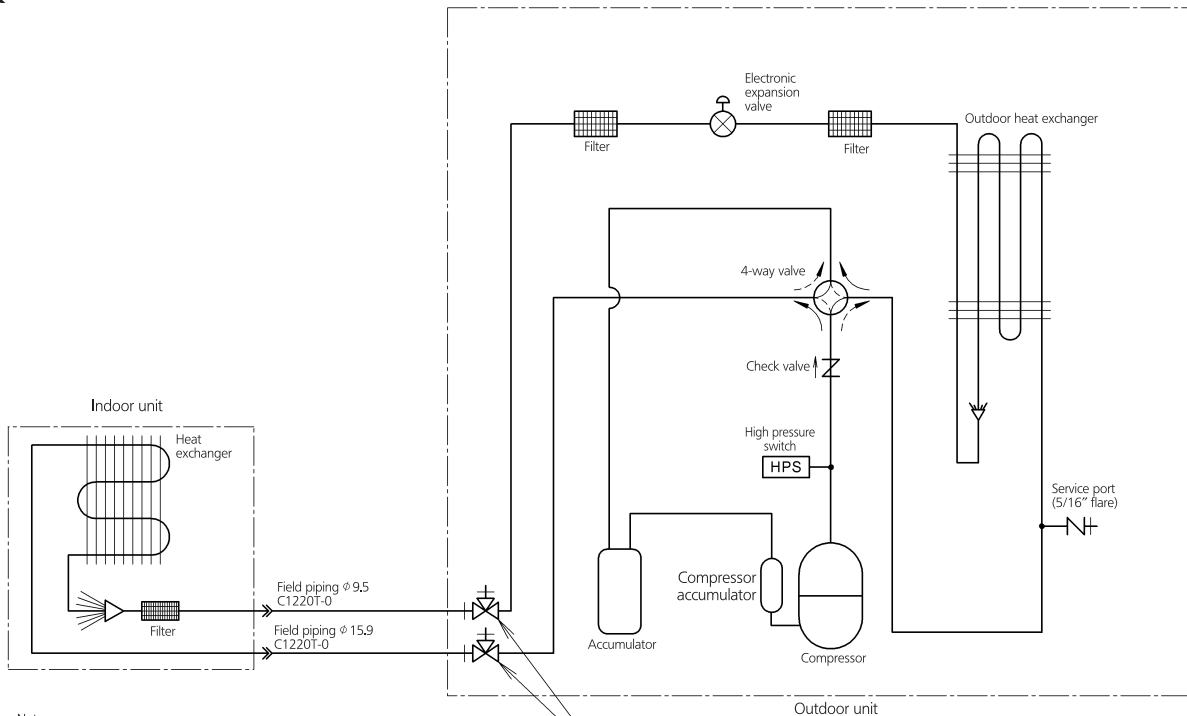


Notes:

1. The pipes between the branch and the indoor units should have the same size as the indoor connections.
2. The check valve is only present in following models: AZQS100 and AZQS125.

Stop valve (with service port 5/16" flare)



AZQS-BY1

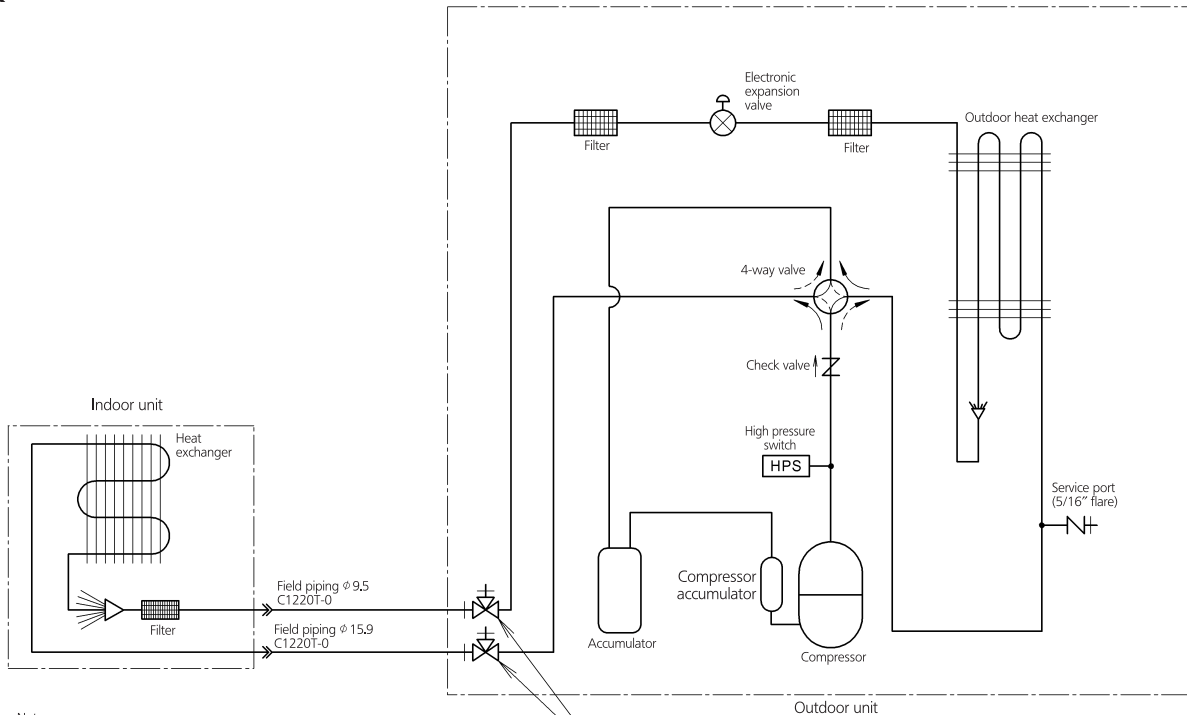

Notes:

1. The pipes between the branch and the indoor units should have the same size as the indoor connections.
2. The check valve is only present in following models: AZQS100 and AZQS125.

Stop valve (with service port 5/16" flare)

